



Coordinated Operations of Lake Powell and Lake Mead

Water Year 2012 Release Volume as a Function of Unregulated Inflow Volume based on March 24-Month Study Conditions

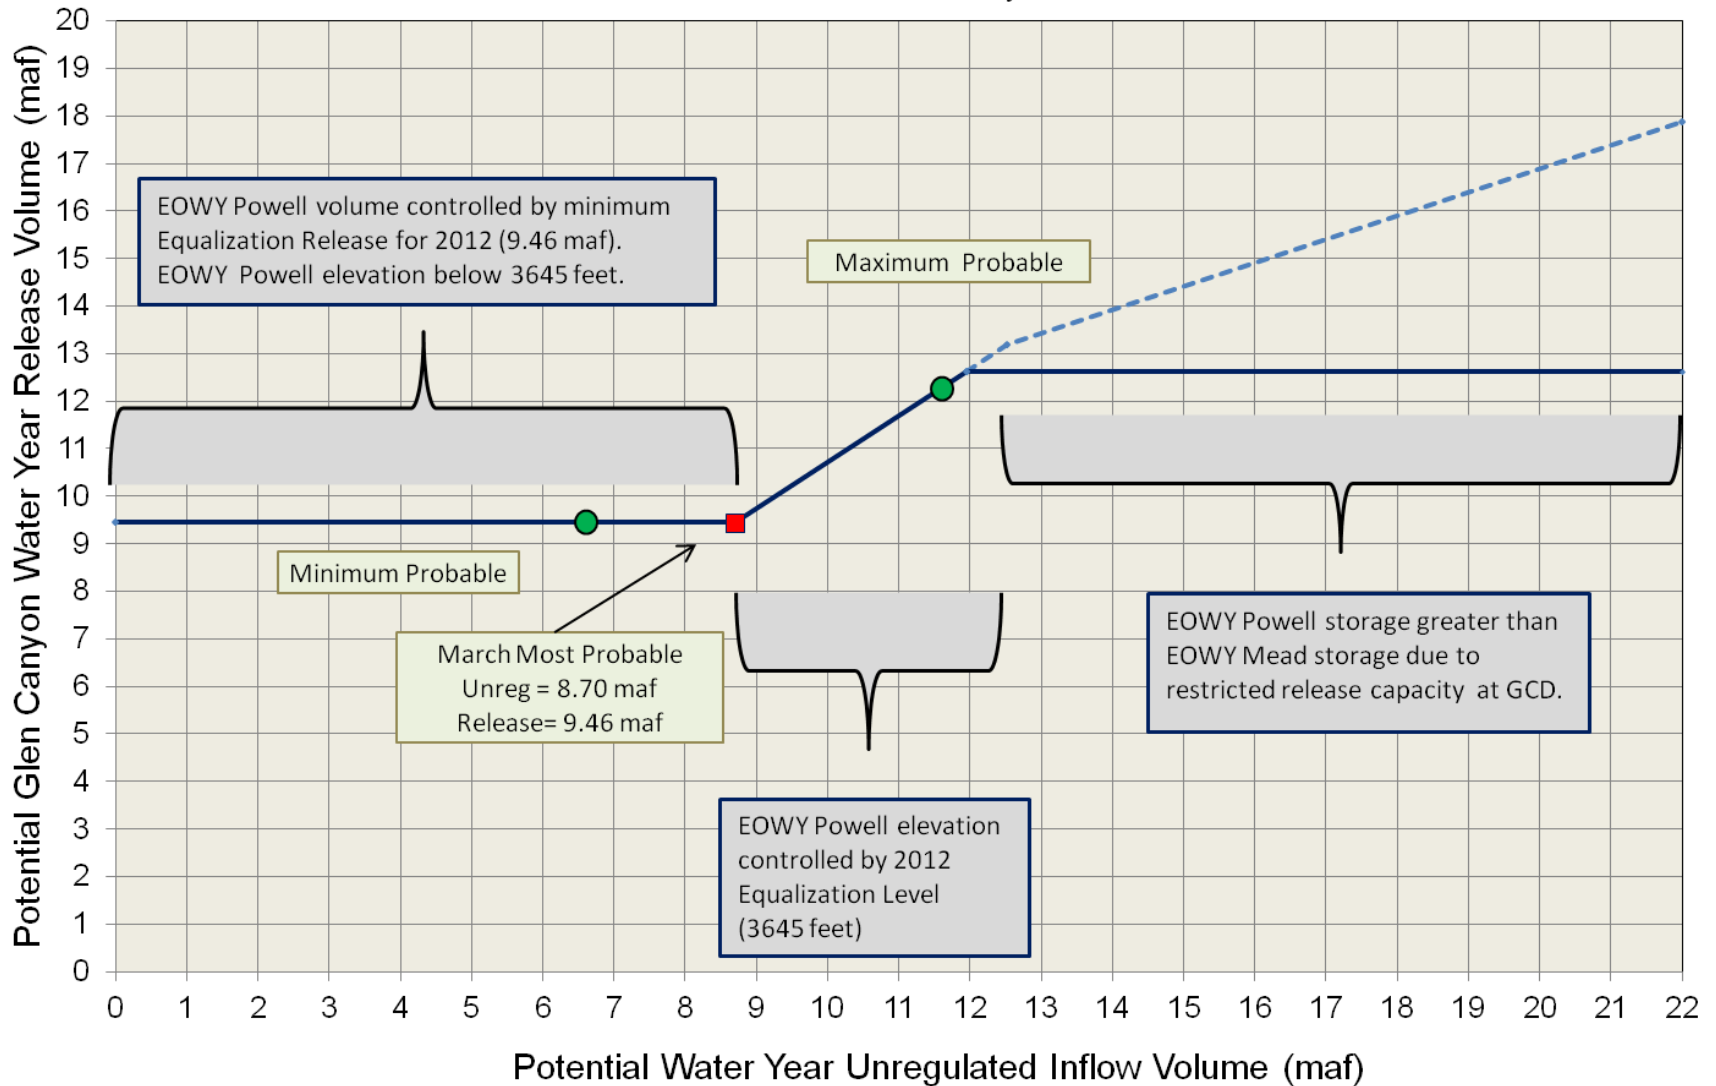


Lake Powell Elevations

Historic and Projected based on Most Recent Inflow Projections

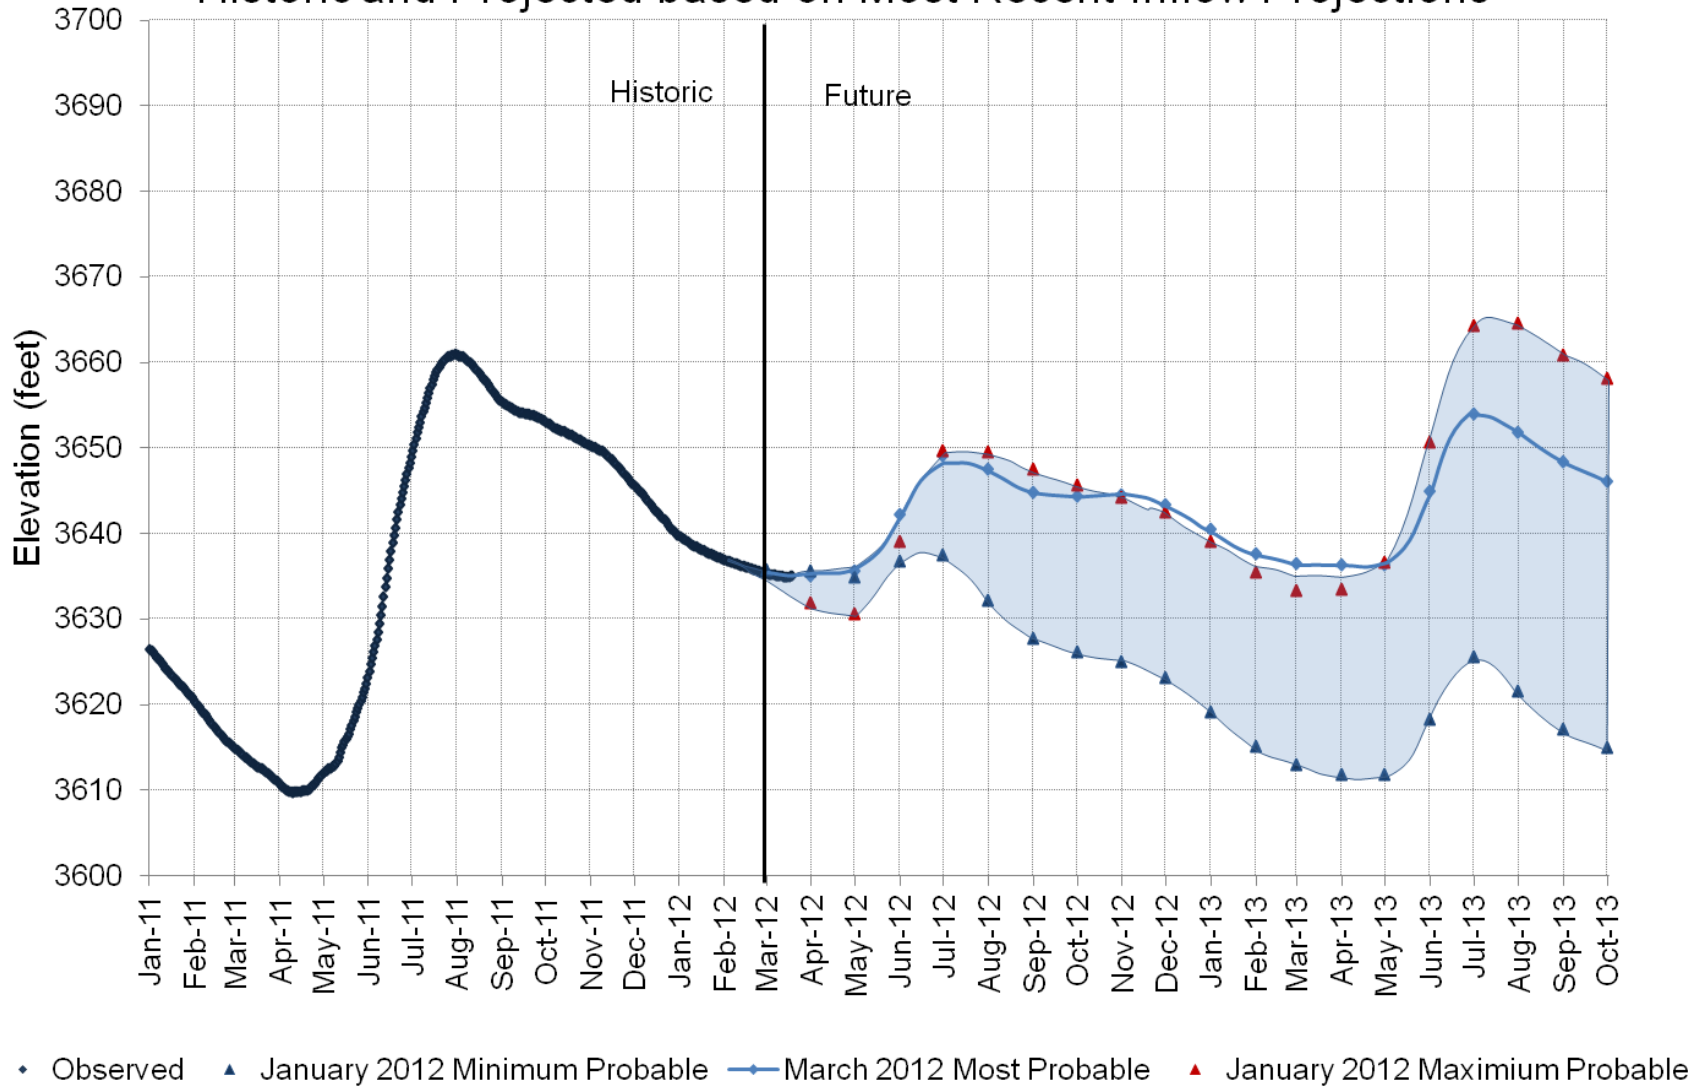

Lake Mead Elevations

Historic and Projected based on Most Recent Inflow Projections

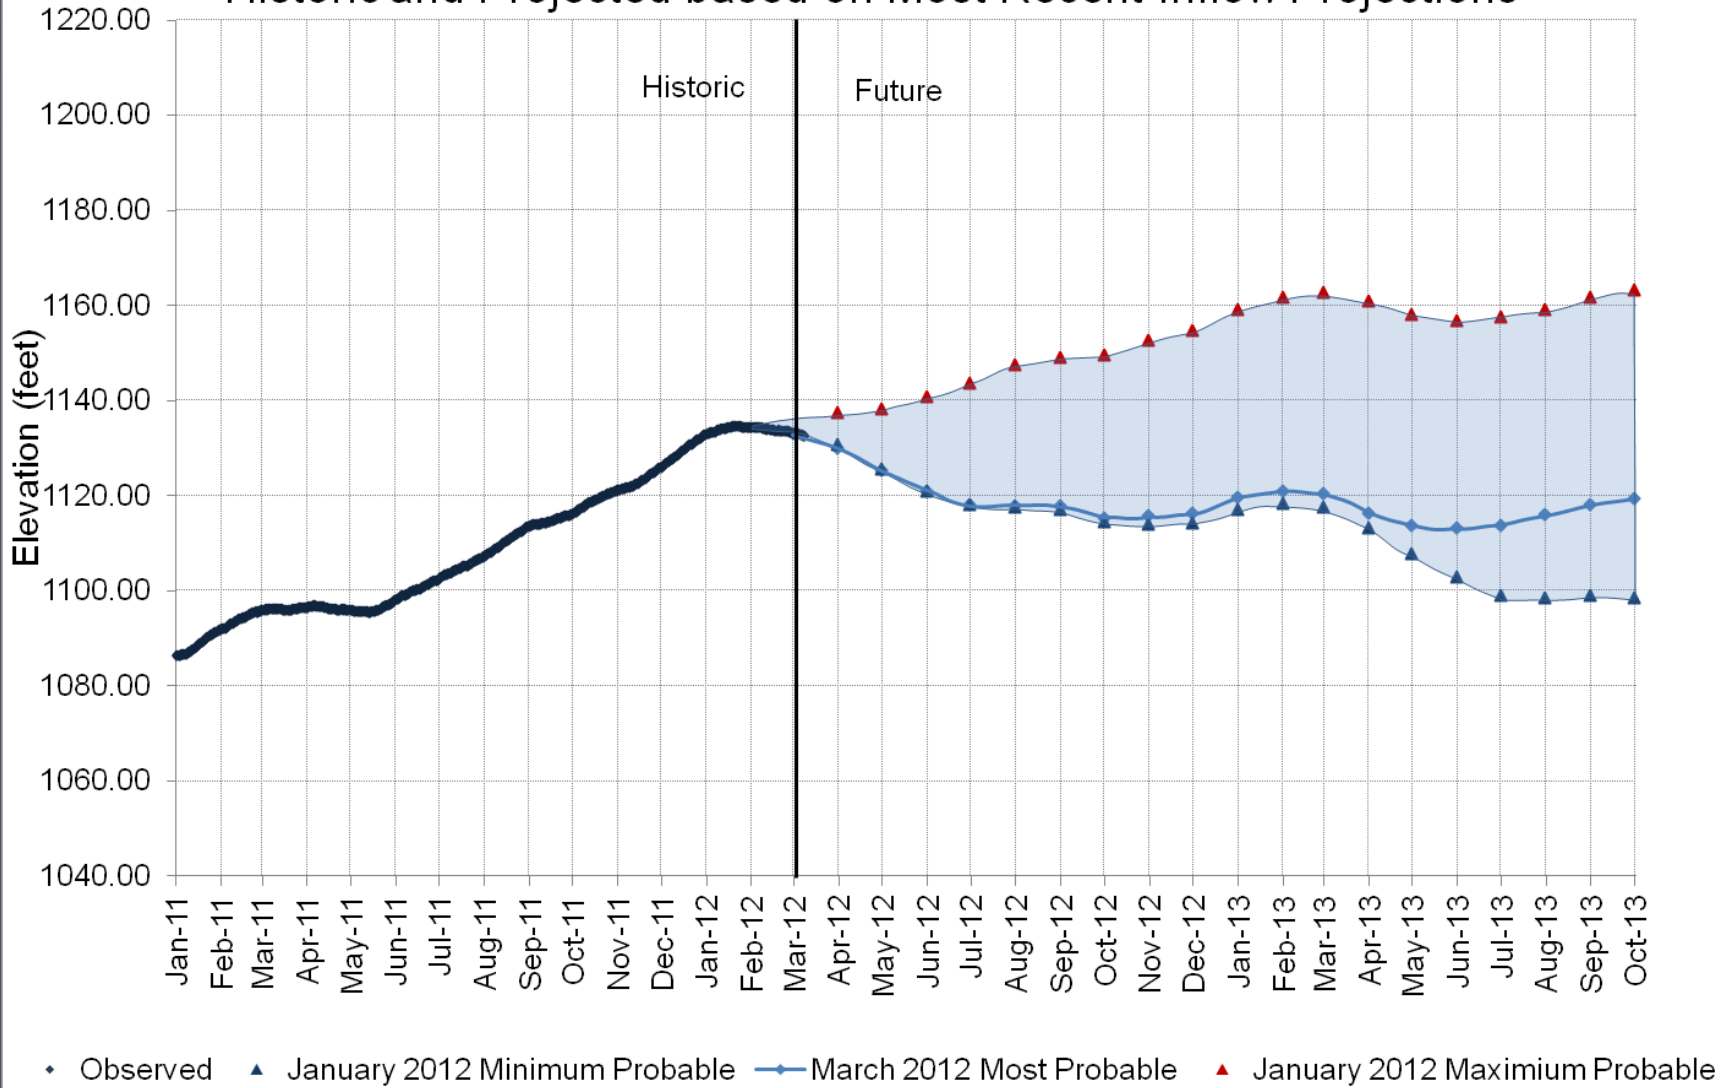


Glen Canyon Power Plant Planned Unit Outage Schedule for Water Year 2012

(updated 3-21-2012)


Unit Number	Oct 2011	Nov 2011	Dec 2011	Jan 2012	Feb 2012	Mar 2012	Apr 2012	May 2012	Jun 2012	Jul 2012	Aug 2012	Sep 2012
1												
2												
3												
4												
5												
6 (3/4 Unit)												
7												
8												
Units Available	5	5.5	5.75	6.75	4.75	4.75 / 6.75	6.75	6.75	6.75	6.75	6.75	4.75
Capacity (cfs)	15,500	20,750	20,750	20,750	14,400	14,200 / 23,800	23,000	23,000	23,000	23,800	23,800	14,800
Capacity (kaf/month)	1030	1099	1223	1130	950	940	1220	1350	1310	1350	1340	990
Max (kaf)	956	1099	1223	852	650	600	900	1350	1310	1350	974	833
Most (kaf)	956	1099	1223	852	650	600	600	600	714	890	800	476
Min (kaf)	956	1099	1223	852	650	600	600	600	714	890	800	476

RECLAMATION

Glen Canyon Dam Hourly Release Pattern MAR 2012

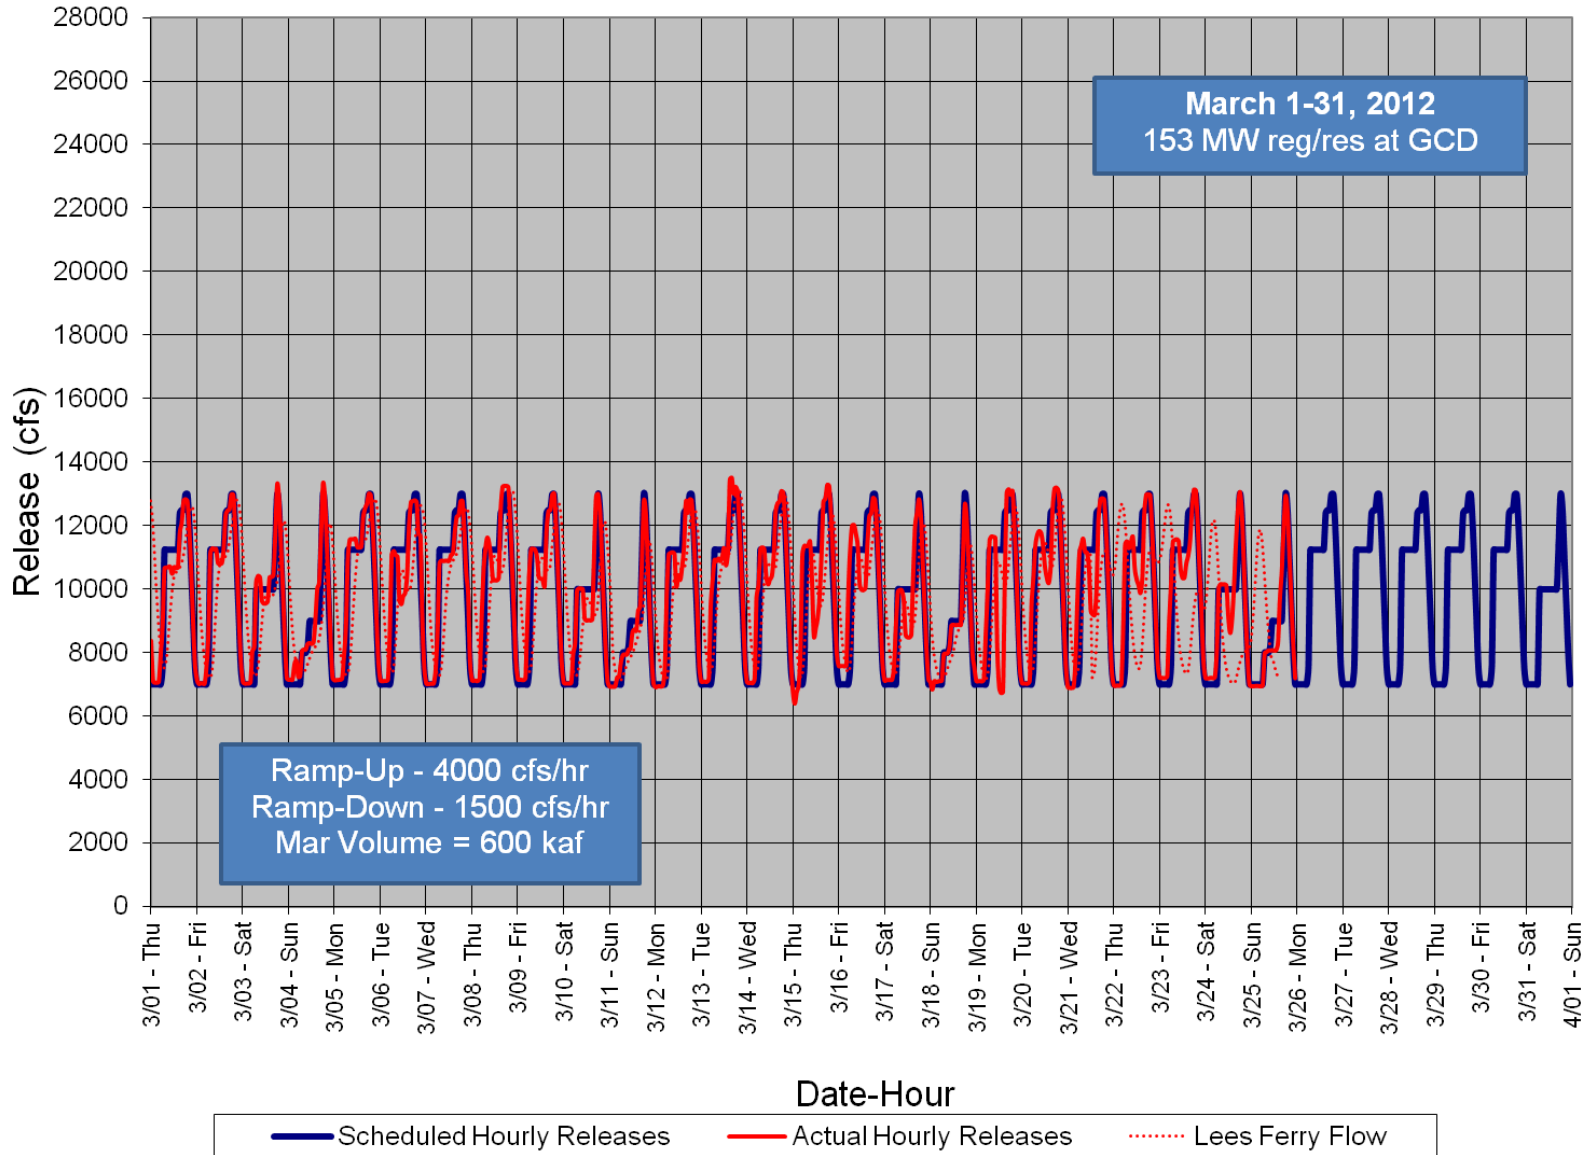

Glen Canyon Dam Hourly Release Pattern APR 2012

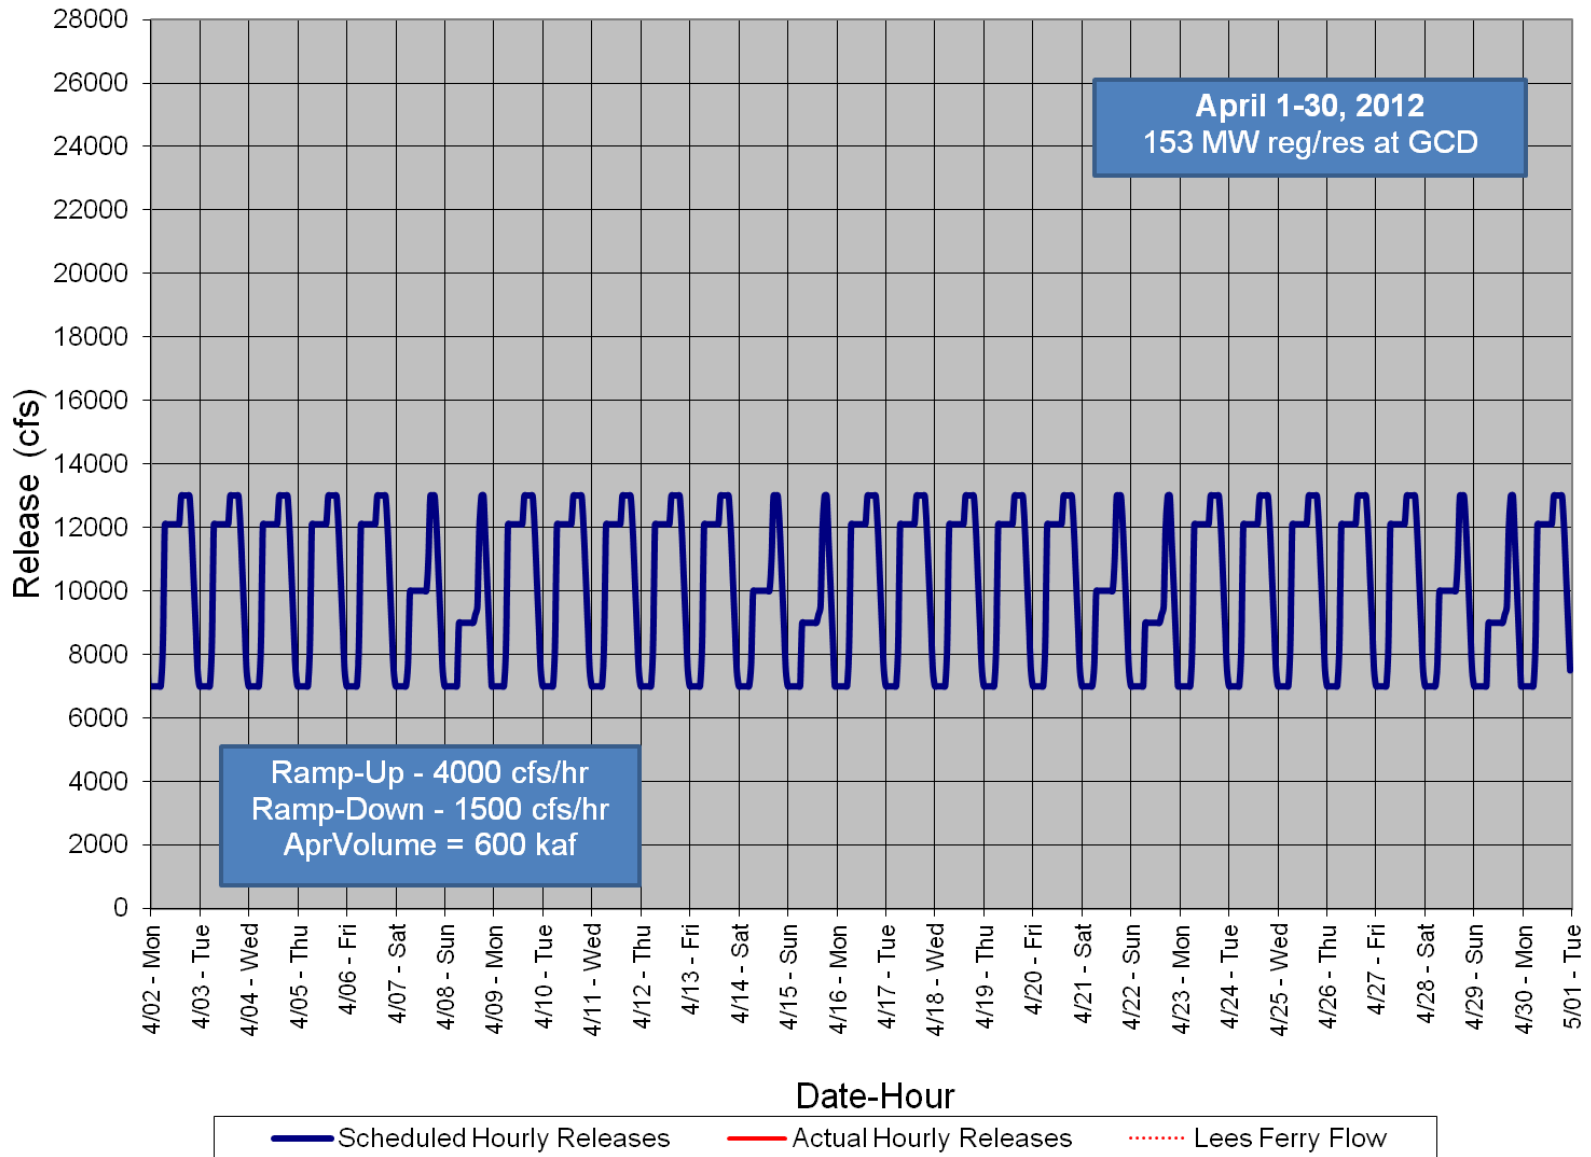

Glen Canyon Dam Hourly Release Pattern MAY 2012

